中国国家强制性产品认证证书

证书编号：2024010305654692

认证委托人名称及地址

ABB 新会低压开关有限公司

广东省江门市新会区今古洲工业开发区

生产者名称及地址

ABB 新会低压开关有限公司

广东省江门市新会区今古洲工业开发区

生产企业名称及地址

ABB 新会低压开关有限公司

广东省江门市新会区今古洲工业开发区

产品名称和系列、型号、规格

指示装置

TYPE C(CP、C2SS、C3SS、CL、CE、CB、CEP)；型号解释见附页

产品标准和技术要求

GB/T 14048.5-2017

上述产品符合《强制性产品认证实施规则　低压电器　低压元器件》（CNCA-C03-02:2024）的要求，特发此证。

发证日期：2024 年 07 月 09 日　　**有效期至：**2029 年 07 月 08 日

证书信息和有效性可扫描下方二维码或登录发证机构网站查验，

也可在认监委网站（www.cnca.gov.cn）查询。

签发：谢肇煦

中国质量认证中心

CHINA QUALITY CERTIFICATION CENTRE

中国质量认证中心有限公司

中国国家强制性产品认证证书

证书编号：2024010305654692

TYPE C(CP、C2SS、C3SS、CL、CE、CB、CEP)
Ui:300V（按钮、选择开关和急停开关，蜂鸣器和带灯按钮），415V（指示灯）；
Uimp:6kV（按钮、选择开关和急停开关和带灯按钮），4kV（蜂鸣器）；
Ith:5A(按钮、选择开关、急停按钮和带灯按钮);
按钮、选择开关、急停按钮、带灯按钮、塑料按钮盒(套装)
AC-15: 120V/3A, 240V/2A（触头 Ag）, 120V/1.5A, 240V/1A（触头 Cu/Ep.Ag）;
DC-13: 24V/0.3A, 125V/0.2A;
LED 指示灯: Ue=110-130VAC, 230VAC, Ie=15mA;
Ue=48VAC/DC,Ie=12mA;Ue=110-130VDC,Ie=7mA; Ue=220VDC, Ie=5mA;
Ue=380VAC,Ie=16mA;Ue=60VAC/DC,415VAC,Ie=17mA;
LED II 指示灯: Ue=48-60VAC/DC，Ie=13-17mA；
Ue=110-130VAC，Ie=15-17mA；Ue=110-130VDC，Ie=8-9mA；Ue=230VAC，Ie=17mA；
Ue=220VDC，Ie=6mA；Ie=2mA(CL2-720), Ue=380-415VAC，Ie= 15-17mA;
白织灯指示灯：Uemax=240VAC;
蜂鸣器(红,黄色带灯):
Ue=110-130VAC,230VAC, Ie=70mA;Ue=110-130VDC,Ie=15mA;
(绿色带灯):Ue=110-130VAC,230VAC,Ie=55mA; Ue=110-130VDC, Ie=15mA;
外壳防护等级：除 LED 和塑料按钮盒(套装) CEP 外，安装在特定面板后头部外壳防护等级可达到 IP66，和尾部端面可达到 IP20。
LED 指示灯尾部端面可达到 IP20,基于标准产品的特殊印刷 LED 指示灯 CL9 安装在特定面板后头部外壳防护等级可达到 IP66 和尾部端面可达到 IP20,没有安装平垫圈的 LED 指示灯 CL9 安装在特定面板,后头部外壳防护等级可达到 IP40 和尾部端面可达到 IP20。
塑料按钮盒(套装) CEP 没有安装保护罩或标牌时外壳防护等级可达到 IP66, 安装保护罩或标牌时外壳防护等级为 IP40。

本页为证书附页，应与证书主页同时使用。

中国质量认证中心
CHINA QUALITY CERTIFICATION CENTRE

中国质量认证中心有限公司

中国国家强制性产品认证证书

证书编号：2024010305654692

型号的解释：



本页为证书附页，应与证书主页同时使用。


中国质量认证中心
CHINA QUALITY CERTIFICATION CENTRE

中国质量认证中心有限公司


中国国家强制性产品认证证书


证书编号：2024010305654692

带灯按钮

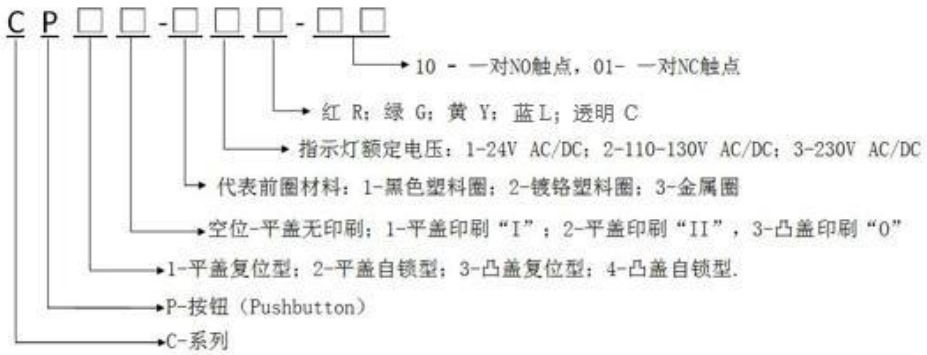

2 位选择开关

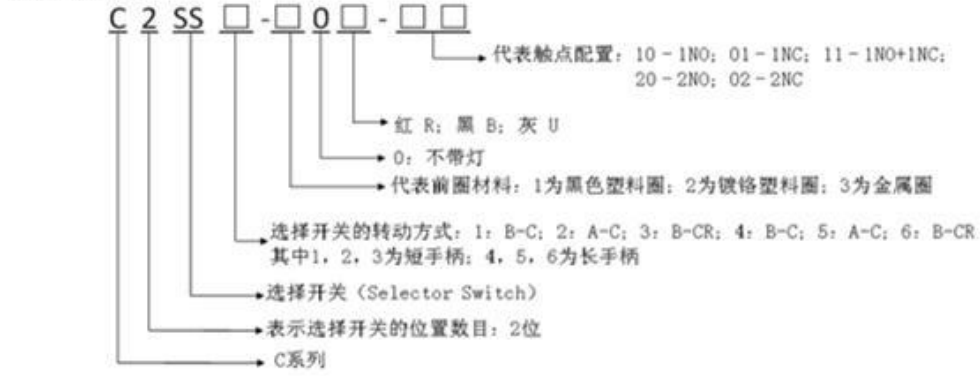

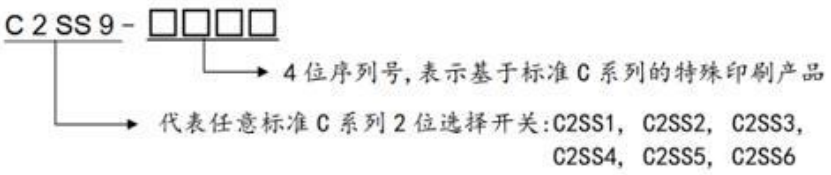


3 位选择开关



中国质量认证中心有限公司

中国国家强制性产品认证证书

证书编号：2024010305654692

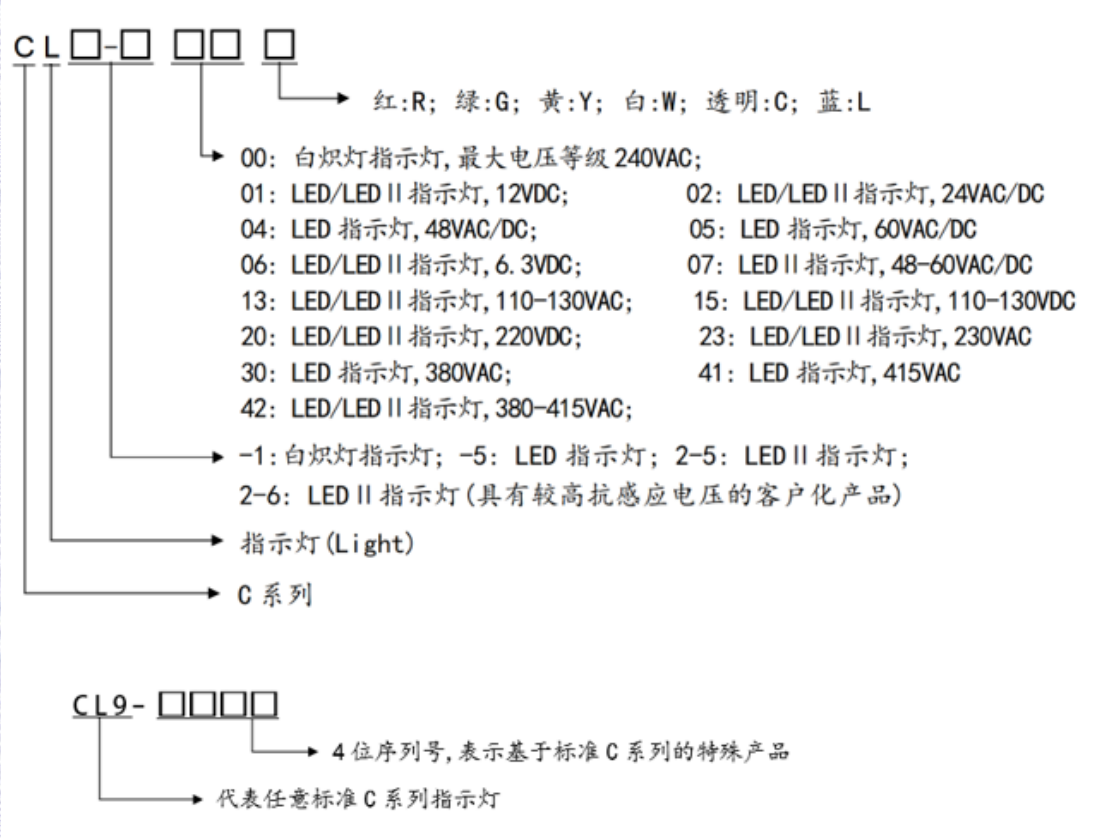

本页为证书附页，应与证书主页同时使用。


中国质量认证中心
CHINA QUALITY CERTIFICATION CENTRE


中国质量认证中心有限公司

中国国家强制性产品认证证书


证书编号：2024010305654692

急停开关

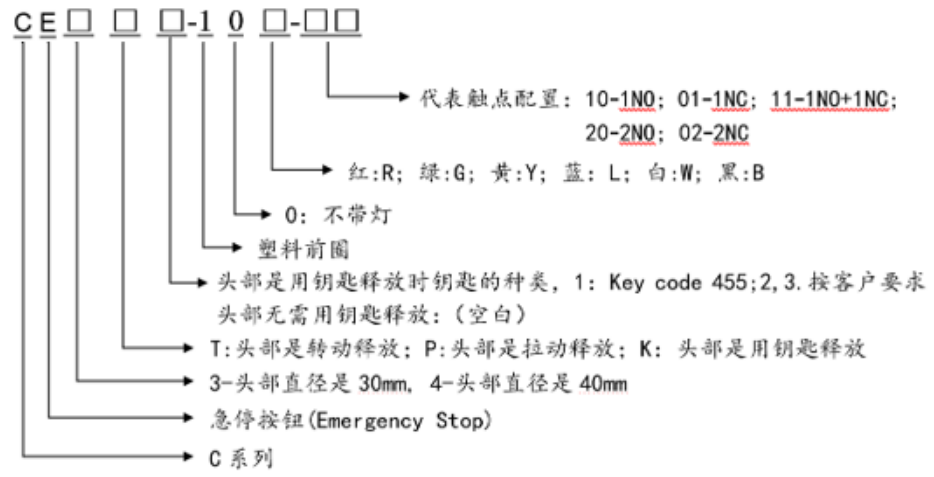

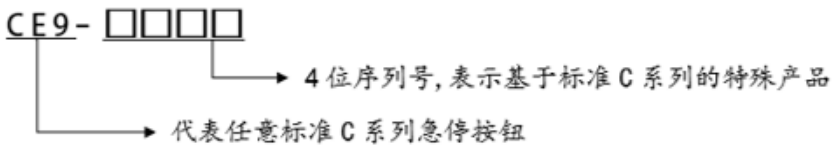

蜂鸣器

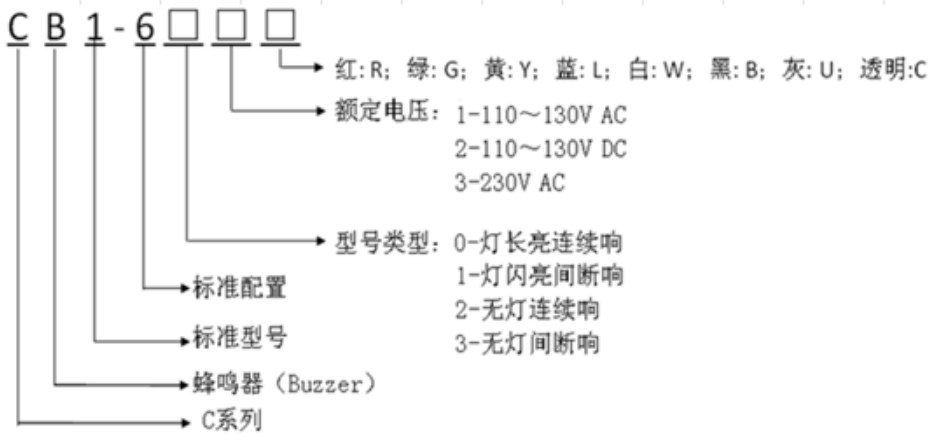

本页为证书附页，应与证书主页同时使用。


中国质量认证中心
CHINA QUALITY CERTIFICATION CENTRE

中国质量认证中心有限公司

中国国家强制性产品认证证书

证书编号：2024010305654692

塑料按钮盒(套装)

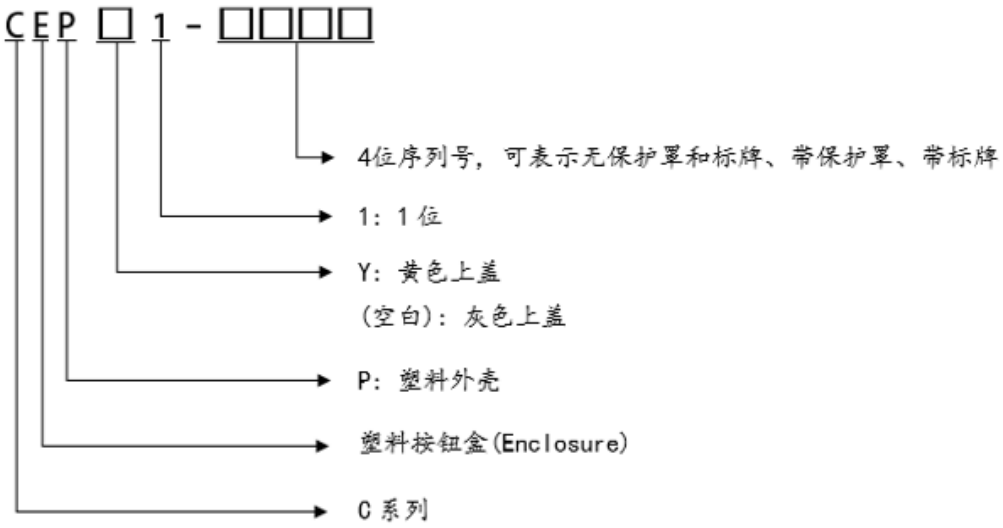

本页为证书附页，应与证书主页同时使用。

中国质量认证中心
CHINA QUALITY CERTIFICATION CENTRE

中国质量认证中心有限公司

本翻译文件不具有法律效力，
不得单独使用
This translated document
does not have legal validity and
cannot be used in isolation

CERTIFICATE FOR CHINA COMPULSORY PRODUCT CERTIFICATION

CERTIFICATE NO.: 2024010305654692

NAME AND ADDRESS OF THE APPLICANT

ABB Xinhui Low Voltage Switchgear Co.,Ltd.
Jinguzhou Industrial Development Zone, Xinhui District, Jiangmen City, Guangdong Province, P.R.China

NAME AND ADDRESS OF THE MANUFACTURER

ABB Xinhui Low Voltage Switchgear Co.,Ltd.
Jinguzhou Industrial Development Zone, Xinhui District, Jiangmen City, Guangdong Province, P.R.China

NAME AND LOCATION OF THE FACTORY

ABB Xinhui Low Voltage Switchgear Co.,Ltd.
Jinguzhou Industrial Development Zone, Xinhui District, Jiangmen City, Guangdong Province, P.R.China

PRODUCT NAME,MODEL AND SPECIFICATION

Pilot devices
TYPE C(CP、C2SS、C3SS、CL、CE、CB、CEP)；See the Appendix

STANDARDS AND TECHNICAL REQUIREMENTS FOR THE PRODUCTS

GB/T 14048.5-2017

This is to certify that the above mentioned product(s) complies with the requirements of implementation rules for compulsory certification(REFNO. CNCA-C03-02:2024).

Valid from: Jul.09,2024 **Valid until:** Jul.08,2029

The certificate information and validity could be checked by scanning the QR code below or logging in to the website of the issuing authority, or on the website of the CNCA (www.cnca.gov.cn).

SIGNATURE: 谢肇煦

中国质量认证中心
CHINA QUALITY CERTIFICATION CENTRE

CHINA QUALITY CERTIFICATION CENTRE CO., LTD.

本翻译文件不具有法律效力，
不得单独使用
This translated document
does not have legal validity and
cannot be used in isolation

CERTIFICATE FOR CHINA COMPULSORY PRODUCT CERTIFICATION

CERTIFICATE NO. : 2024010305654692

TYPE C(CP、C2SS、C3SS、CL、CE、CB、CEP)
Ui:300V（Button, select switch and emergency stop switch, buzzer and with light button），415V（Lights）；
Uimp:6kV（ Button, select switch and emergency stop switch and with light button），4kV（Buzzer）；
Ith:5A(Button, select switch and emergency stop switch and with light button)；
Button, select switch, emergency stop button, with lights button, plastic button box (set)；
AC-15: 120V/3A, 240V/2A（Contacts Ag）, 120V/1.5A, 240V/1A（Contacts Cu/Ep.Ag）; DC-13: 24V/0.3A, 125V/0.2A;
LED Lights: Ue=110-130VAC, 230VAC, Ie=15mA;
Ue=48VAC/DC,Ie=12mA;Ue=110-130VDC,Ie=7mA; Ue=220VDC, Ie=5mA;
Ue=380VAC,Ie=16mA;Ue=60VAC/DC,415VAC,Ie=17mA;
LED II Lights: Ue=48-60VAC/DC，Ie=13-17mA；
Ue=110-130VAC，Ie=15-17mA；Ue=110-130VDC，Ie=8-9mA；Ue=230VAC，Ie=17mA；
Ue=220VDC，Ie=6mA；Ie=2mA(CL2-720), Ue=380-415VAC，Ie= 15-17mA;
White fabric lamp indicator：Uemax=240VAC;
Buzzer (red, yellow with light)：
Ue=110-130VAC,230VAC, Ie=70mA;Ue=110-130VDC,Ie=15mA;
(Green with lights):Ue=110-130VAC,230VAC,Ie=55mA; Ue=110-130VDC, Ie=15mA;
Housing Rating: in addition to LED and plastic button box (set) CEP, installed in a specific panel after the head housing rating can reach IP66, and IP20 rear end face. Led indicator tail face can reach IP20, special printed LED indicator CL9 based on standard products can be installed in a specific panel head housing protection level can reach IP66 and tail face can reach IP20, the LED indicator CL9 without a flat washer is mounted on a specific panel, with a rear housing rating of IP40 and rear end face IP20. Plastic Push-button case (set) CEP case protection rating IP66 without protective cover or sign, protective cover or sign installation case protection rating IP40.

This page is attached to the certificate and should be used at the same time as the certificate page.

本翻译文件不具有法律效力，
不得单独使用
This translated document
does not have legal validity and
cannot be used in isolation

CERTIFICATE FOR CHINA COMPULSORY PRODUCT CERTIFICATION

CERTIFICATE NO. : 2024010305654692

This page is attached to the certificate and should be used at the same time as the certificate page.

中国质量认证中心
CHINA QUALITY CERTIFICATION CENTRE

CHINA QUALITY CERTIFICATION CENTRE CO., LTD.

http://www.cqc.com.cn Building 5, Section 9, No. 188, Nansihuan Xilu, Beijing 100070 P. R. China Tel: +86 10 83886666